



MLK @ Ortiz NORTH IMS to TOC Fiber Panel 3

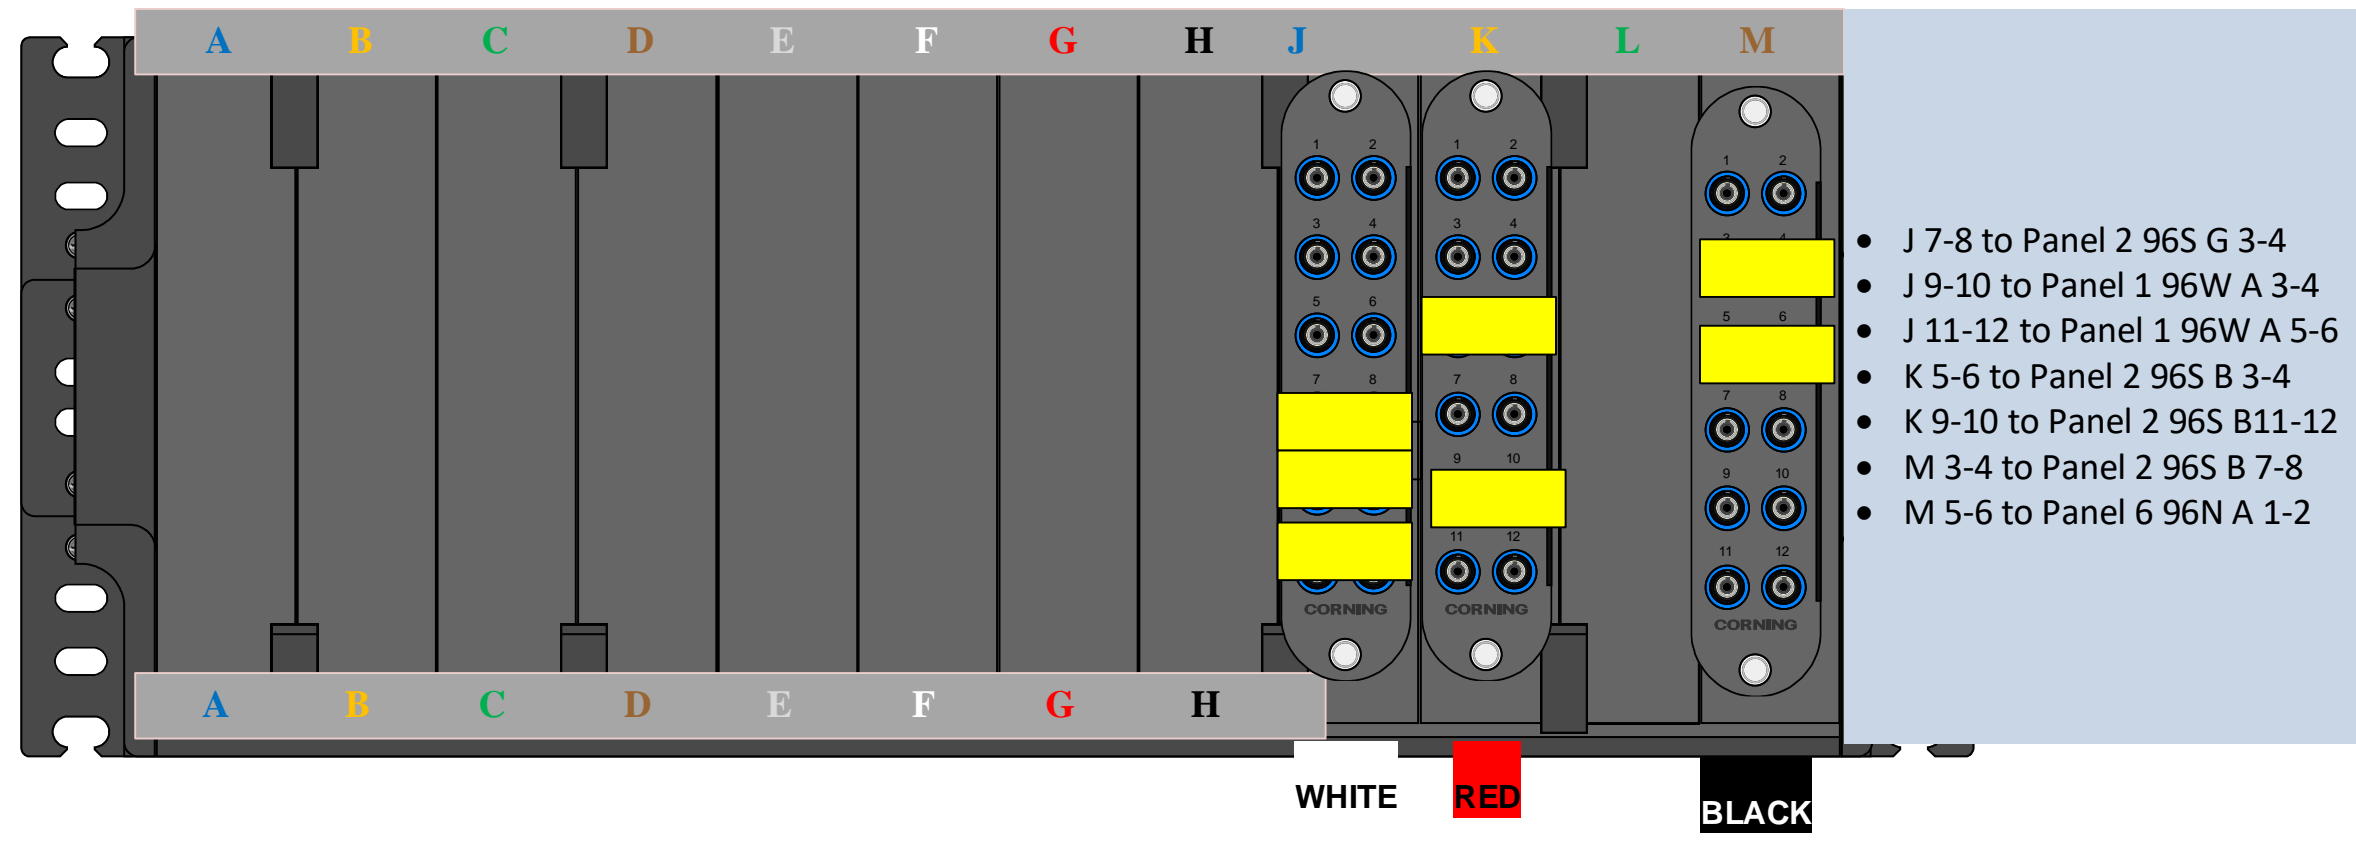


- J 7-8 to Panel 2 96S G 3-4
- J 9-10 to Panel 1 96W A 3-4
- J 11-12 to Panel 1 96W A 5-6
- K 5-6 to Panel 2 96S B 3-4
- K 9-10 to Panel 2 96S B11-12
- M 3-4 to Panel 2 96S B 7-8
- M 5-6 to Panel 6 96N A 1-2

MLK @ Ortiz 96 North to Server Room Fiber Panel 6

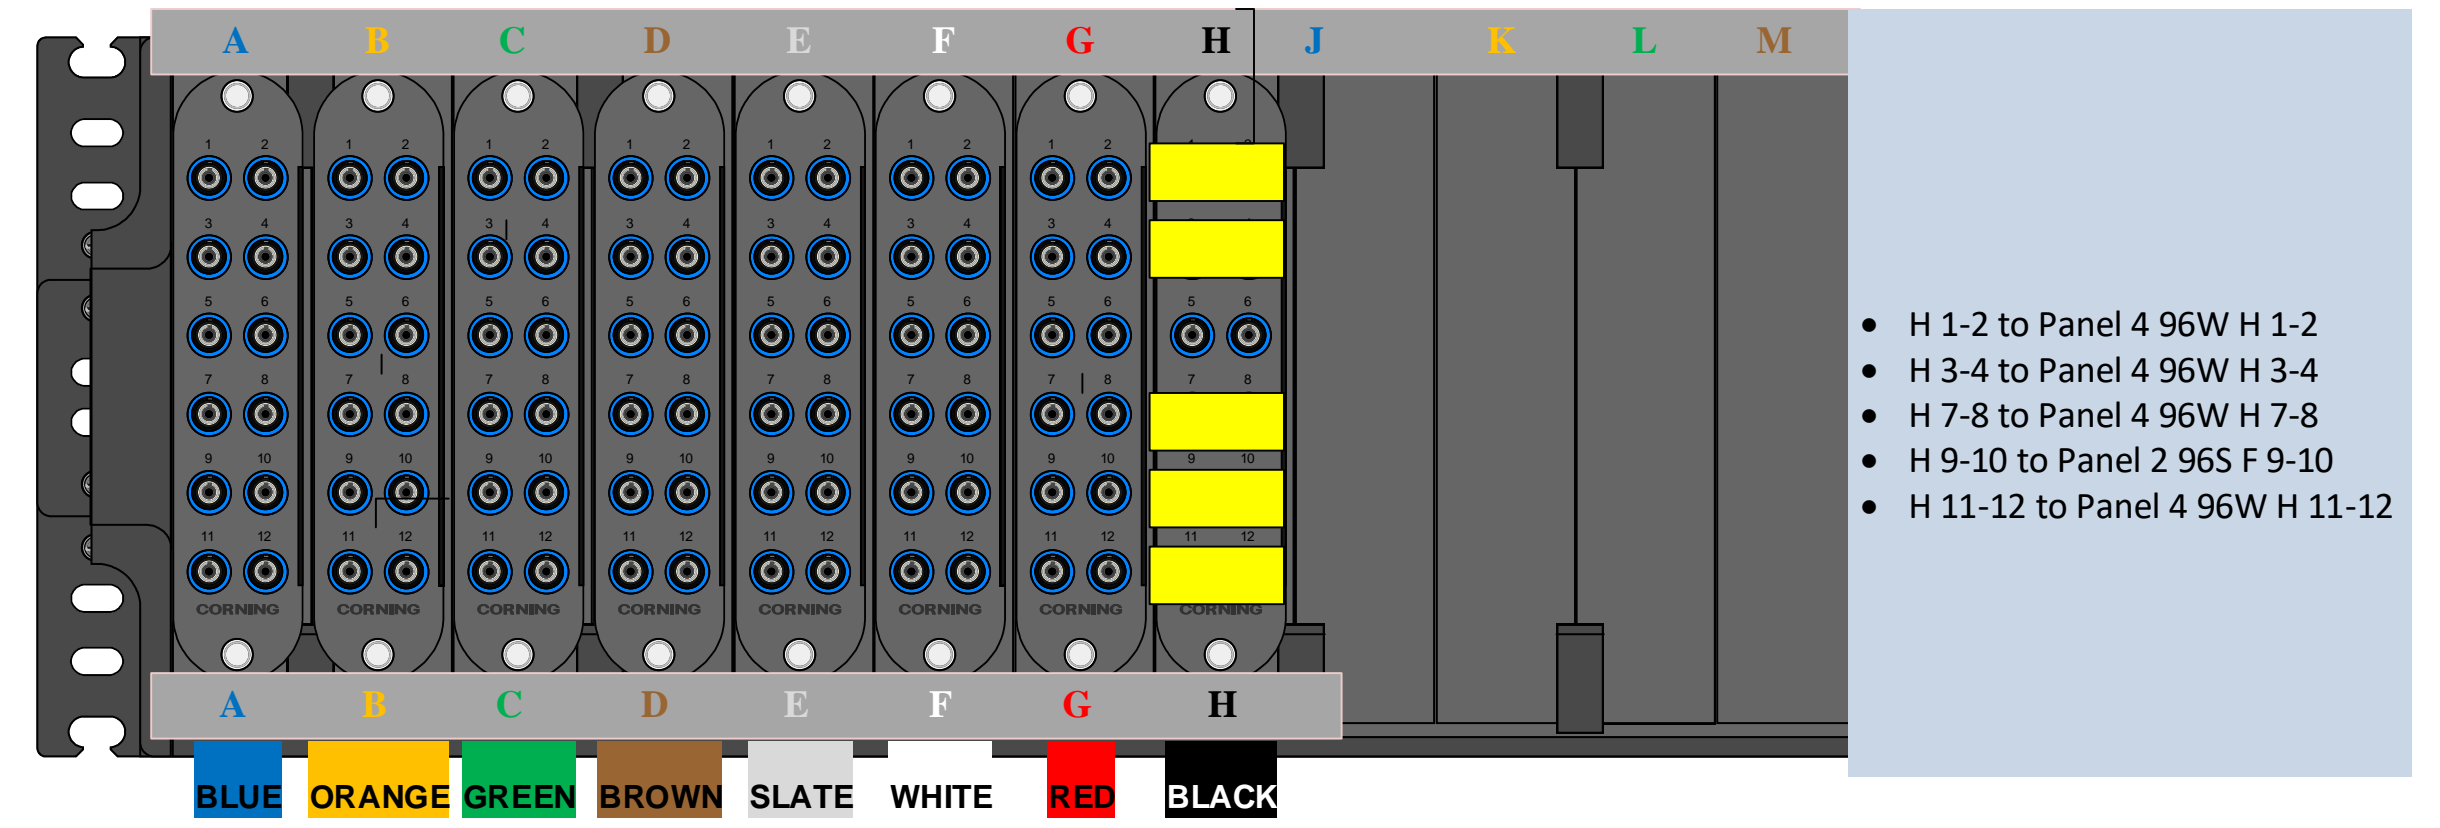


- H 1-2 to Panel 4 96W H 1-2
- H 3-4 to Panel 4 96W H 3-4
- H 7-8 to Panel 4 96W H 7-8
- H 9-10 to Panel 2 96S F 9-10
- H 11-12 to Panel 4 96W H 11-12

MLK @ Ortiz to Railroad West Panel 1

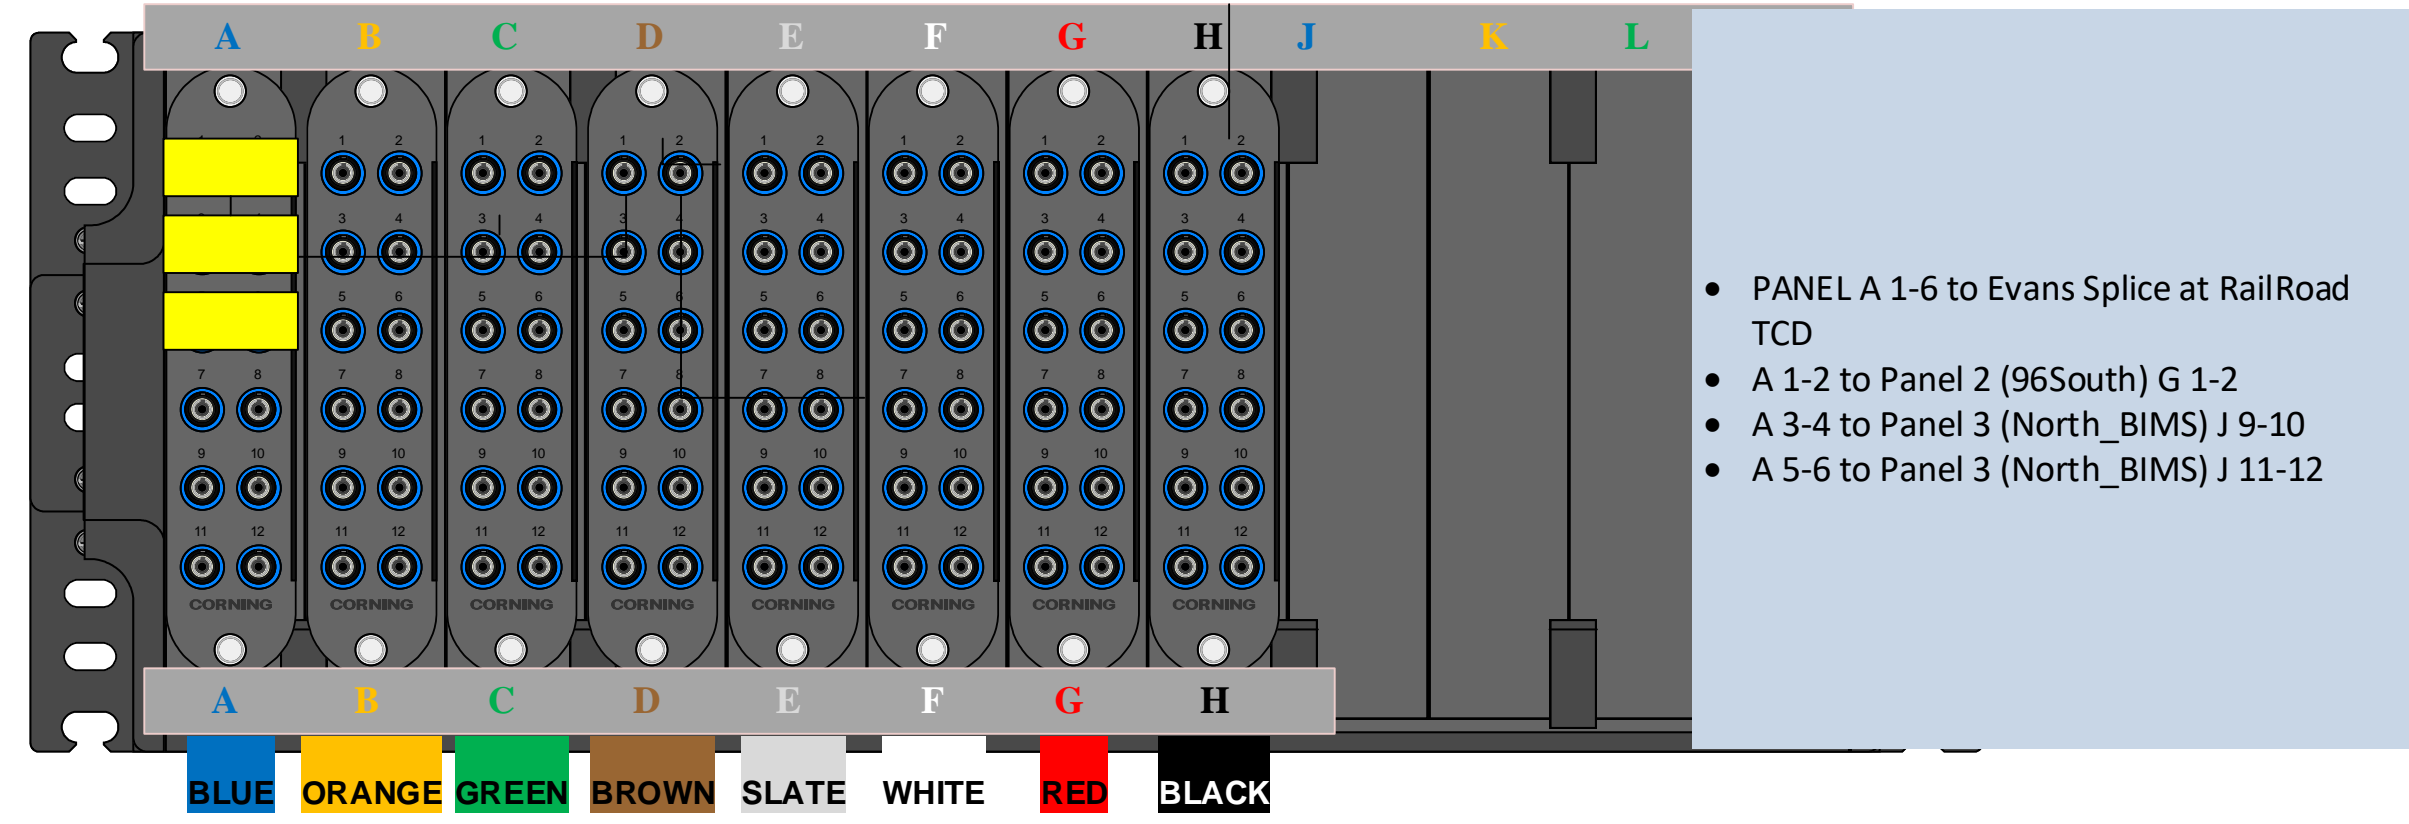


- PANEL A 1-6 to Evans Splice at RailRoad TCD
- A 1-2 to Panel 2 (96South) G 1-2
- A 3-4 to Panel 3 (North_BIMS) J 9-10
- A 5-6 to Panel 3 (North_BIMS) J 11-12

MLK @ Ortiz 96 East Fiber Panel 5

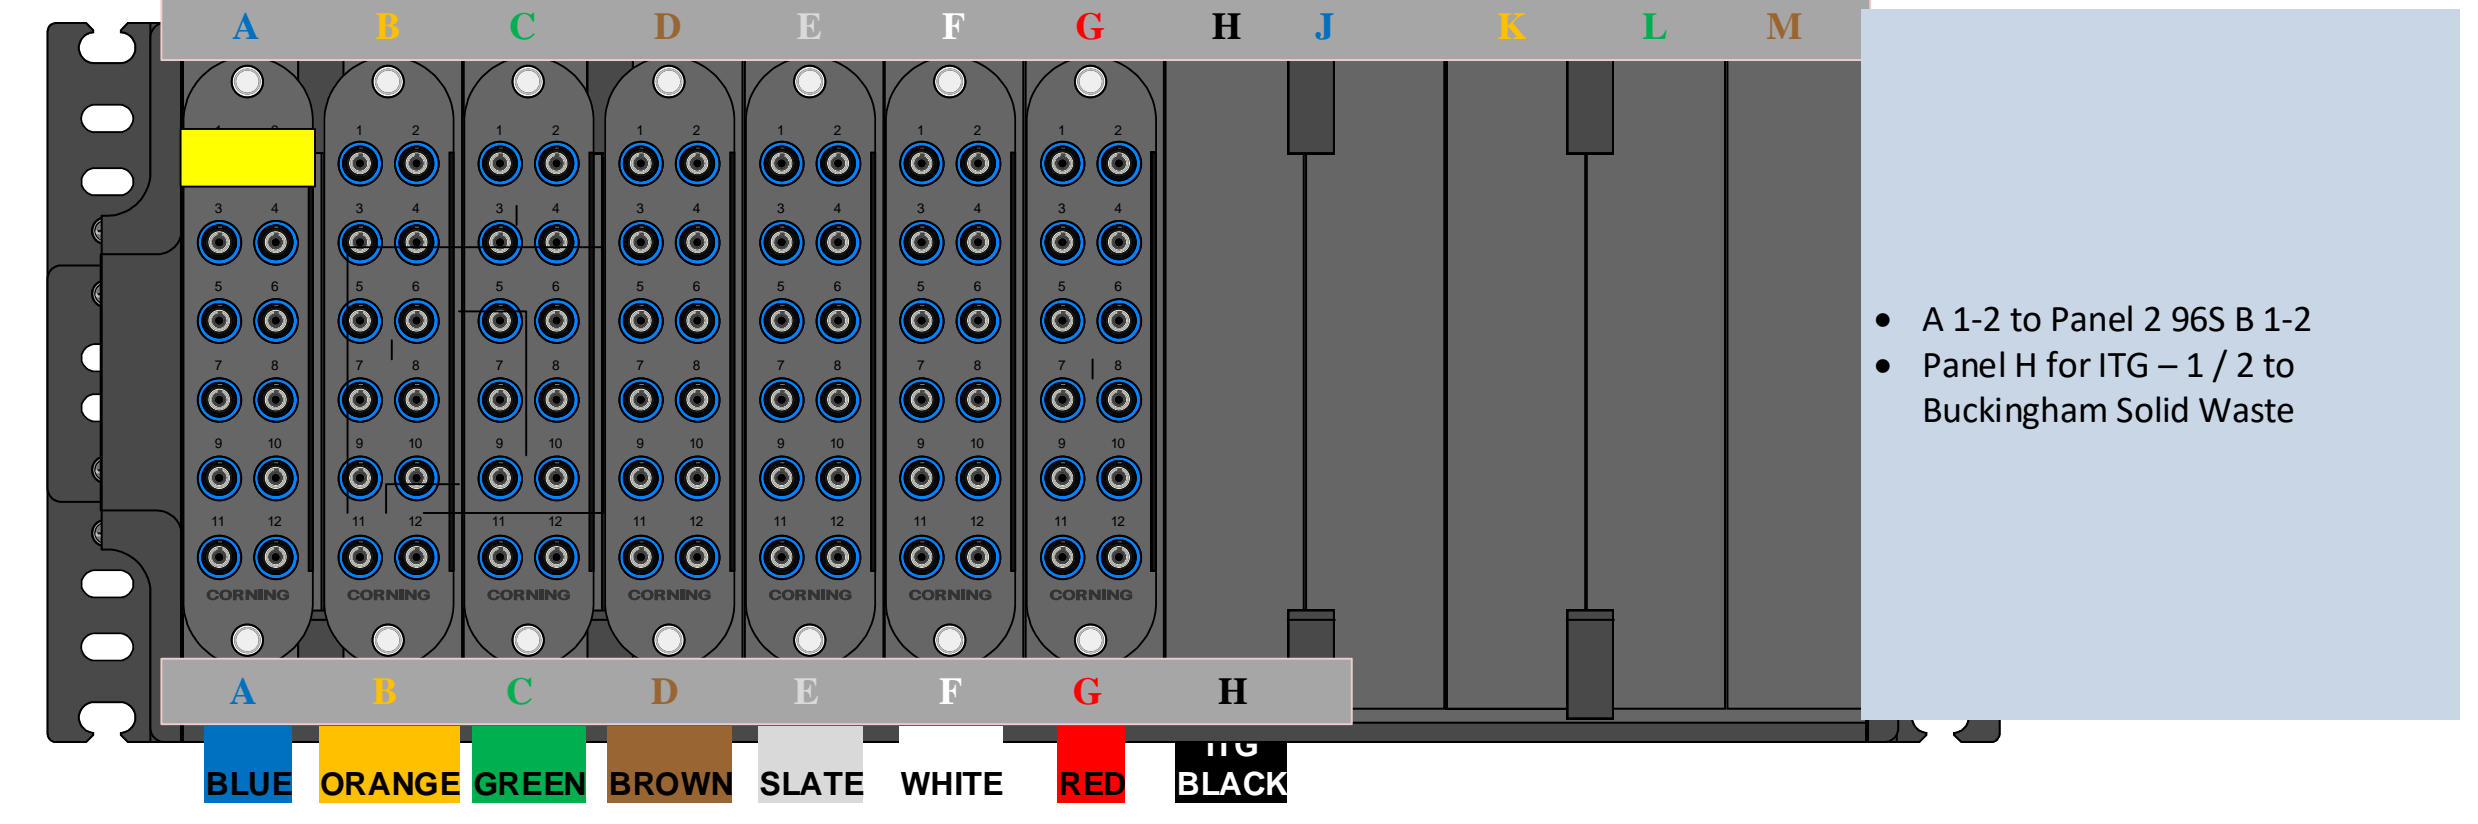


- A 1-2 to Panel 2 96S B 1-2
- Panel H for ITG - 1 / 2 to Buckingham Solid Waste

MLK @ Ortiz 96 West Fiber Panel 4

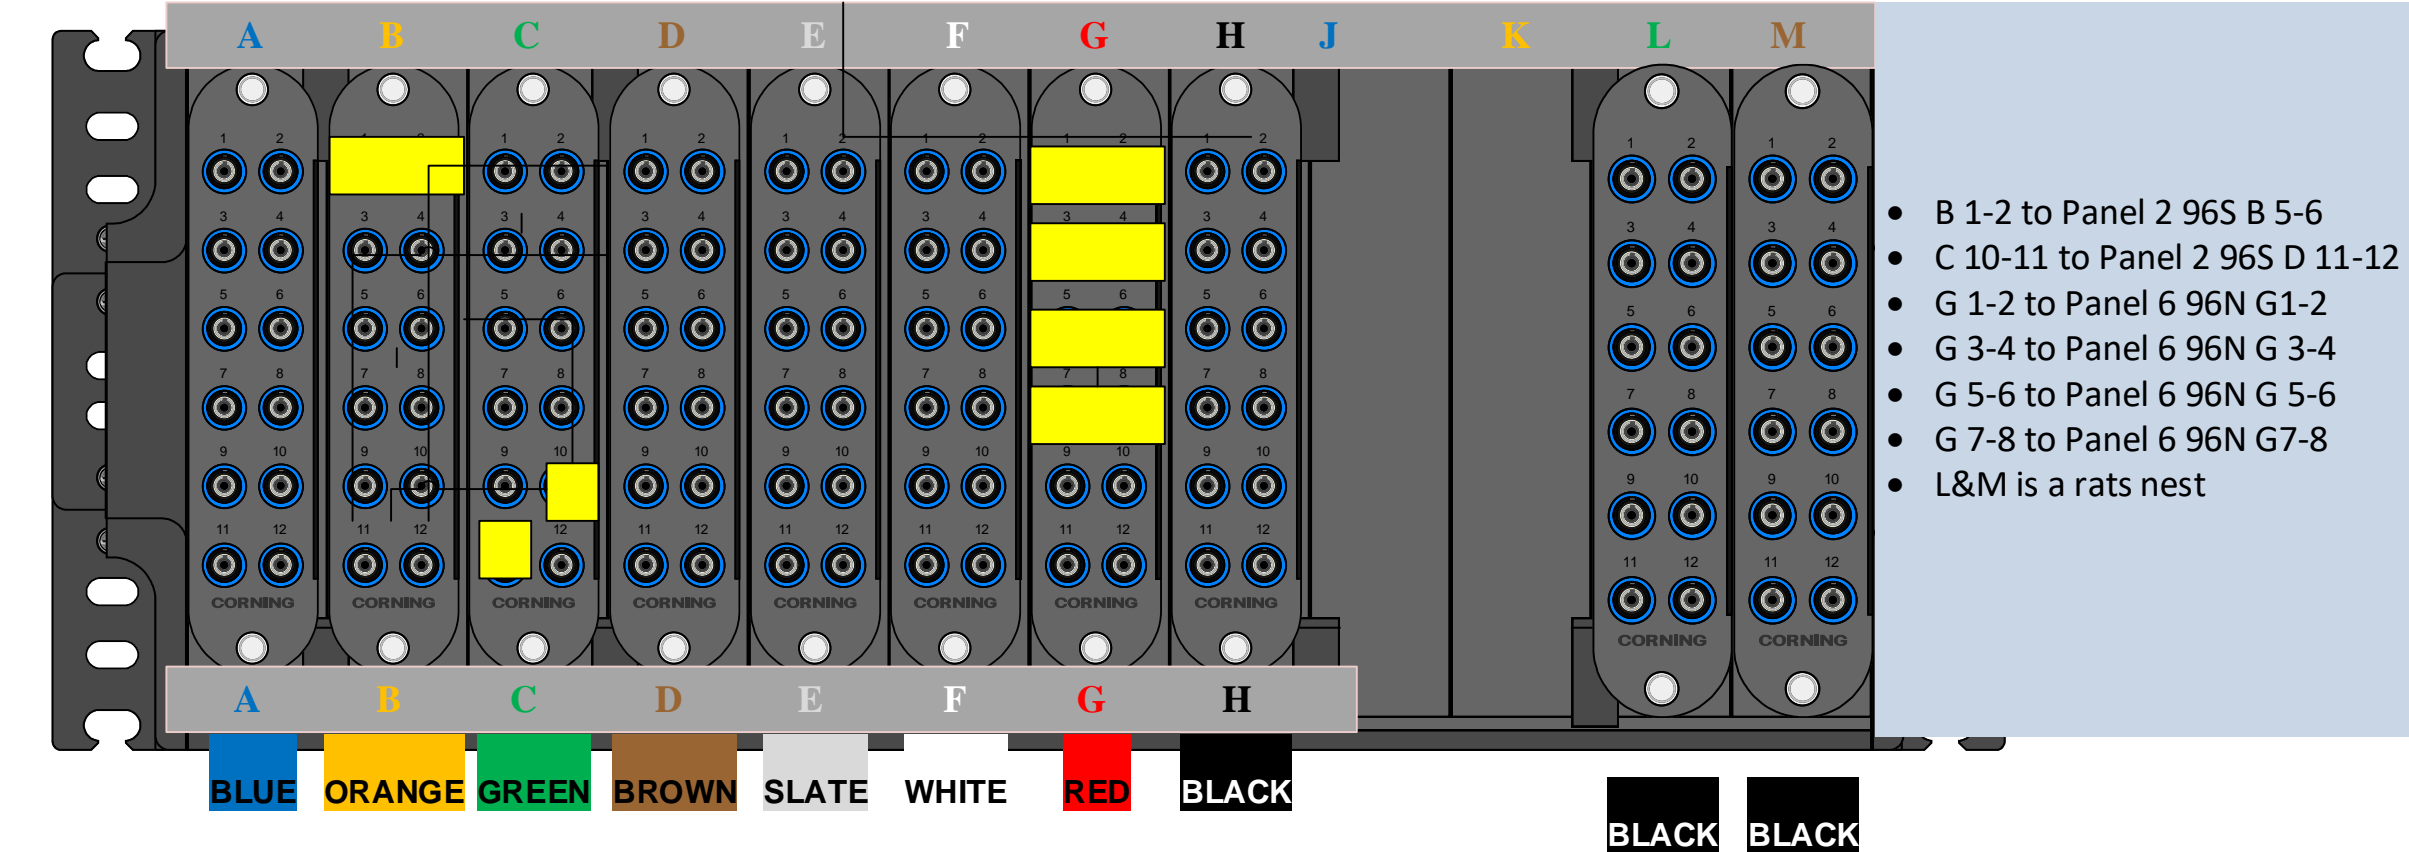

- B 1-2 to Panel 2 96S B 5-6
- C 10-11 to Panel 2 96S D 11-12
- G 1-2 to Panel 6 96N G1-2
- G 3-4 to Panel 6 96N G 3-4
- G 5-6 to Panel 6 96N G 5-6
- G 7-8 to Panel 6 96N G7-8
- L&M is a rats nest

MLK @ Ortiz 96 South Fiber

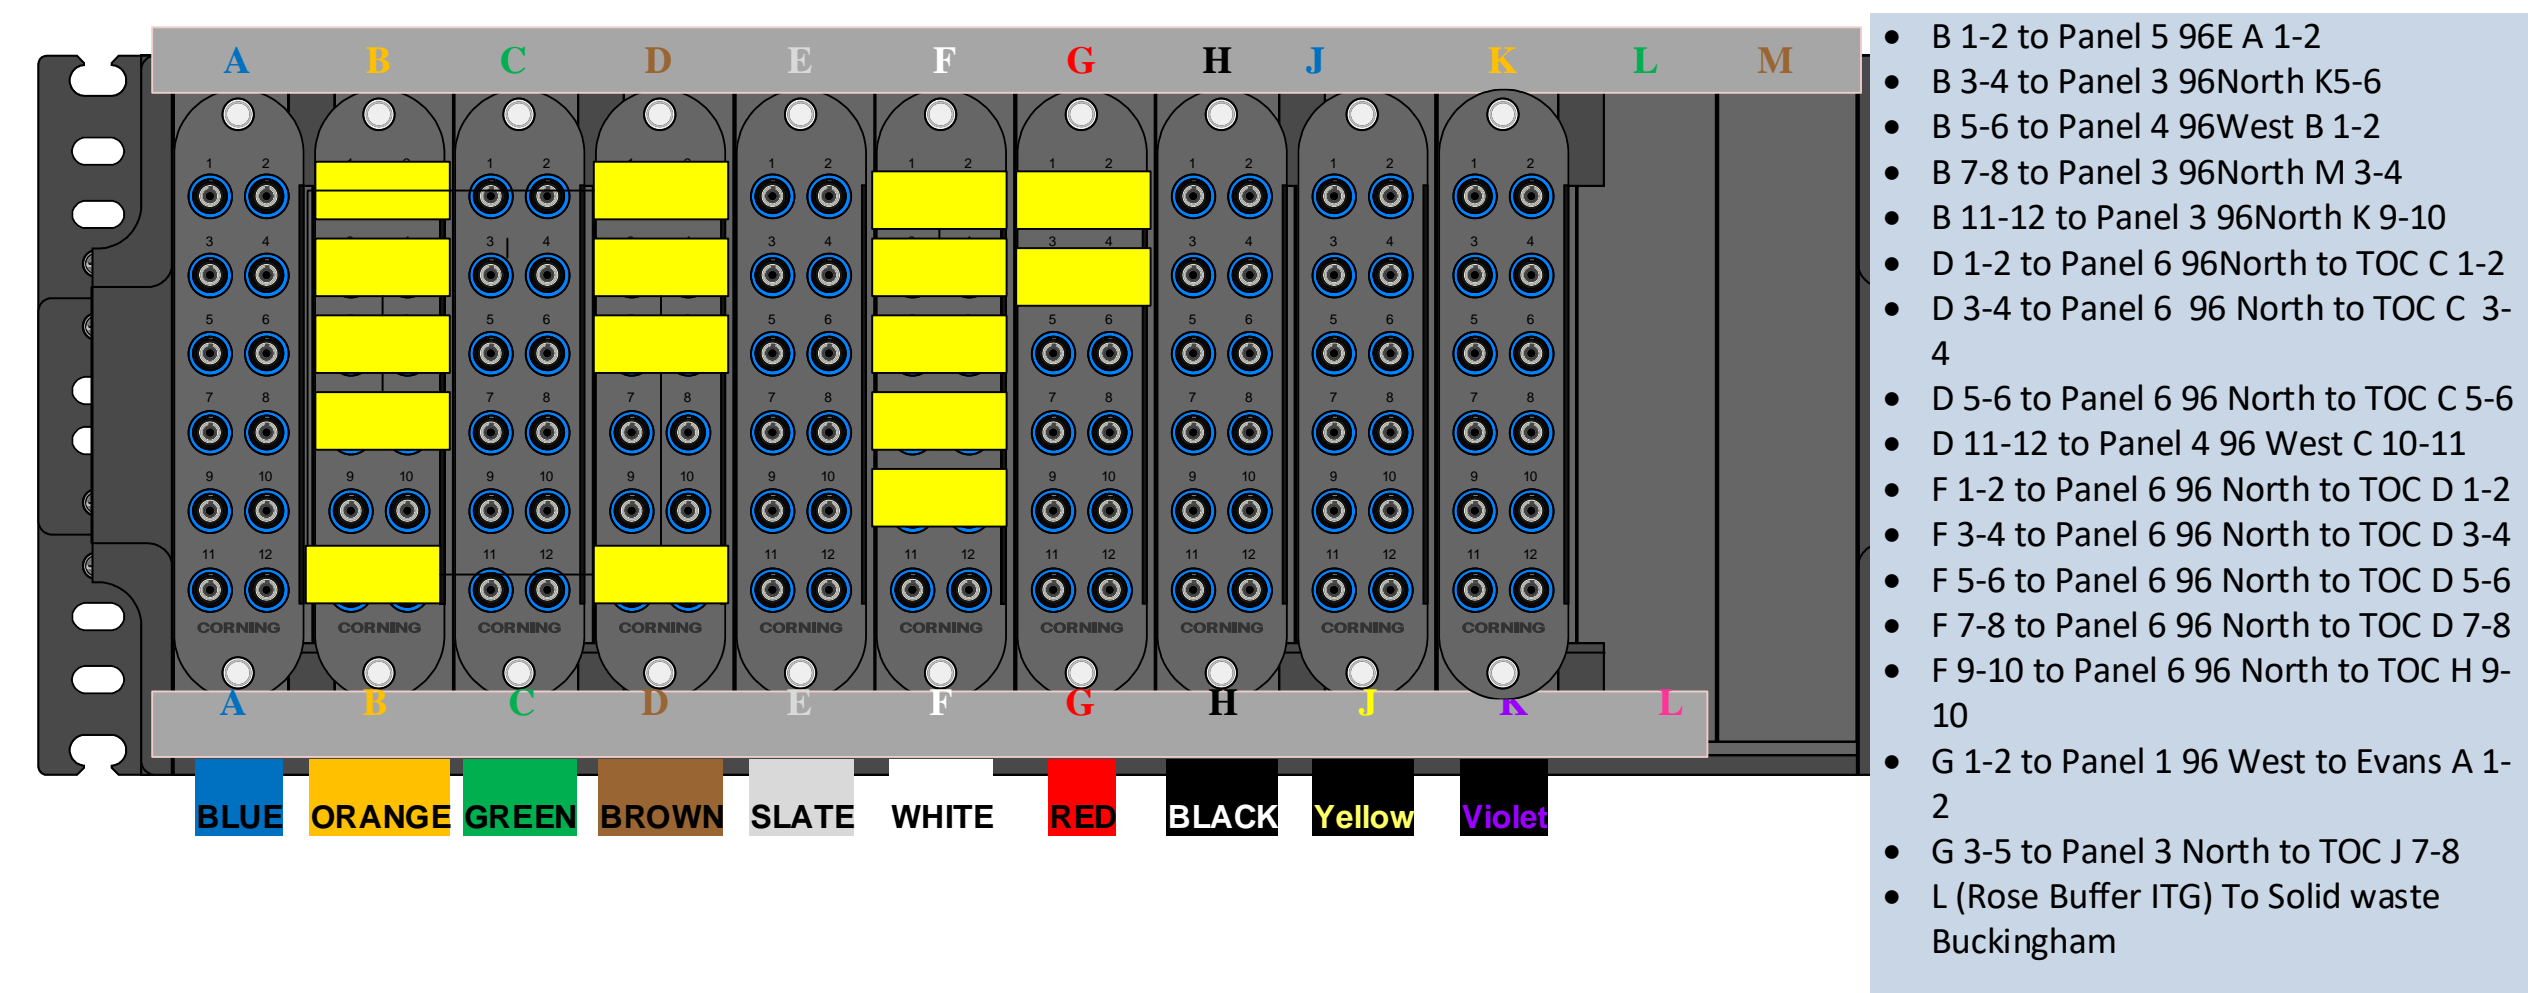

- B 1-2 to Panel 5 96E A 1-2
- B 3-4 to Panel 3 96North K5-6
- B 5-6 to Panel 4 96West B 1-2
- B 7-8 to Panel 3 96North M 3-4
- B 11-12 to Panel 3 96North K 9-10
- D 1-2 to Panel 6 96North to TOC C 1-2
- D 3-4 to Panel 6 96 North to TOC C 3-4
- D 5-6 to Panel 6 96 North to TOC C 5-6
- D 11-12 to Panel 4 96 West C 10-11
- F 1-2 to Panel 6 96 North to TOC D 1-2
- F 3-4 to Panel 6 96 North to TOC D 3-4
- F 5-6 to Panel 6 96 North to TOC D 5-6
- F 7-8 to Panel 6 96 North to TOC D 7-8
- F 9-10 to Panel 6 96 North to TOC H 9-10
- G 1-2 to Panel 1 96 West to Evans A 1-2
- G 3-5 to Panel 3 North to TOC J 7-8
- L (Rose Buffer ITG) To Solid waste Buckingham